


---

ABB MEASUREMENT & ANALYTICS | DATA SHEET

## **EBS852 (Contrac)**

### Electronic unit

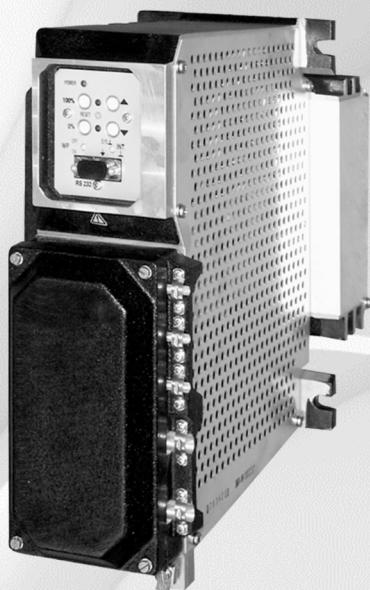

—  
For the continuous control of  
Contrac actuators RHD(E) and  
RSD(E)

—  
**Processor-controlled electronic unit according to the frequency converter principle**

—  
**Power supply 115 V AC or 230 V AC**

—  
**Conventional signal interface (0/4 to 20 mA / 24 V)**

—  
**Digital communication via RS232 and HART**

—  
**Additional functions such as process controller, maintenance computer, programmable characteristics**

—  
**Simple configuration and parameter setting via graphical user interface**

—  
**Torque and speed variation**

—  
**Reliable for short positioning times**

—  
**Rack installation, IP rating IP 20**

## Brief description

The electronic unit builds the interface between the actuator and the control system.

During continuous positioning, the electronic unit varies the motor torque continuously until the actuator force and the control valve force are balanced. High response sensitivity and high positioning accuracy with short positioning time ensure an excellent control quality and a long actuator life.

## Operating principles

The actuator continuously responds to a set point signal. The motor is permanently under voltage (operating mode S9 - 100 % stall-proof according to IEC 60034-1 / EN 60034-1) and gently increases or reduces the torque on the electronic unit in proportion to the  $\Delta Y$  signal (the difference between the Y set point and the Y position signal).

The actuator is not subject to temperature derating, i.e., there are no restrictions, even at the maximum permissible ambient temperature. Where a state of balance exists, the actuator force and process force are equivalent and the actuator keeps the final control element in the required position.

The classification of the 'S9 - 100 % overload protected' Contrac actuator in accordance with IEC 60034-1 / EN 60034-1 by far exceeds the requirements for the highest class, 'continuous modulation, class D' in accordance with EN 15714-2.

The Contrac actuator offers extensive process optimization capabilities thanks to its high-precision and highly dynamic operation.

## Electronic unit

Electronic units are available for assembly in the field near the actuator, remotely in a mounting rack or for integrated assembly (smallest actuator type). In addition to the terminals, the electronic unit contains the microprocessor, frequency converter for motor control, analog and binary inputs and outputs, PROFIBUS® or HART® communication interfaces, the commissioning and service field and a plug connection to connect a PC.

No matter what the motor power of the respective actuator is, all electronic units are supplied single-phase by 230 V or 115 V mains supply (50 Hz or 60 Hz).

The commissioning and service field enables the end positions and direction of rotation to be set on the actuator. Moreover, status information is displayed using LEDs. Push buttons can be used to operate the actuator and set the operating mode (Automatic, Out of Service).

## Analog signal and power input

For analog control, the set point entry is received from the control system through a 0 to 20 mA or 4 to 20 mA current value. Signal monitoring is possible. Should the signal leave the pre-defined limits, the actuator will perform the set safety procedure (e.g. 'Lock in last position' or 'Drive to safety position').

The position feedback is also given through a 0 to 20 mA or 4 to 20 mA feedback signal. There are 3 digital inputs and 3 digital outputs available in addition to the analog signal.

If a digital input is activated, it will take priority over the set point signal (manual mode takes priority over automatic mode).

The following digital input configurations are possible:

Configuration	Digital input 1	Digital input 2	Digital input 3
OFF	No function	No function	No function
Manual intervention	Manual mode / Automatic mode switching	Travel command in OPEN direction	in CLOSE direction
Rapid traverse	Rapid traverse mode / Automatic mode switching	Rapid traverse travel command in OPEN direction	travel command in CLOSE direction
Step controller	ON / OFF step controller activation	Step controller pulses in OPEN direction	Step controller pulses in CLOSE direction

## ... Brief description

The digital output function is freely selectable for each output. The following functions are available:

Function	Description
Ready to operate	Signaling of device status.
Signal end position 0 %	Actuator has reached the 0 % position.
Signal end position 100 %	Actuator has reached the 100 % position.
Signal limit value 1 rising	While the signal level is rising, the actuator has reached the position defined as limit value 1.
Signal limit value 1 falling	While the signal level is falling, the actuator has reached the position defined as limit value 1.
Signal limit value 2 rising	While the signal level is rising, the actuator has reached the position defined as limit value 2.
Signal limit value 2 falling	While the signal level is falling, the actuator has reached the position defined as limit value 2.
Collective failure	Drive function is no longer given. The actuator is no longer available.
Collective alarm	Parameters in the Contrac interface system have adopted values, which make a failure in the near future likely. The actuator remains functional.
Local operation	The actuator is operated via the local control station (ISF)
Rapid traverse + direction	Actuator is moving at rapid traverse speed in + direction (only for 2-motor version).
Rapid traverse control -direction	Actuator is moving at rapid traverse speed in -direction (only for 2-motor version).

## Step controller operation

In the 'step controller' operating mode the incoming control commands are received as pulses at digital inputs 2 and 3 these are upward-integrated into an internal memory. The memory uses these pulses to generate an 'artificial' internal set point which the actuator then follows. This process is as easy on the control valve and actuator operation as the analog control process.

## Rapid traverse mode

The actuator is operated exactly in the same operating mode as in the analog control mode. On activation of digital inputs 2 or 3, the actuator moves at twice the rated operating speed and half the torque in the corresponding direction. Just before the end position is reached, the actuator travel speed is automatically switched back to the set speed, at which the remaining distance is covered.

## Speed

Contrac actuators offer different speed adjustments for both directions, independently of actuator torque or actuator force. Furthermore, a speed characteristics curve can be set with three different speed values for each direction. The actuator speed is steplessly adapted to the rate of change in speed of the set point value. This ensures a highly dynamic and extremely precise control process. In order to preserve the control valve, the actuator speed is automatically reduced before the end position is reached.

## Torque/Force

The torque and actuator force setting options are comparable to the speed setting options. 50 %, 75 % and 100 % of the rated output value can be selected. The electronic unit alters the motor actuation according to the selected value.

## Set point monitoring

The set point can be monitored for compliance with the adjustable limit values. Should the set point exceed the upper limit value or fall below the lower limit value, the actuator will perform the previously defined safety action. 'Lock in current Position' or 'Move to pre-defined safety position' are available as safety actions.

## Ambient conditions

### Temperature

Different temperature versions are available, depending on the actuator type.

The power-up period is not subject to derating, i.e. even at the maximum permissible ambient temperature, the actuator ensures maximum control precision and dynamics during a power-up period of 100 %.

### Corrosion protection

Contrac actuators and electronic units have been designed for operation in extreme ambient conditions. They satisfy the requirements of atmospheric corrosivity category C5-I (highly polluted industrial atmospheres) for protection against external corrosion in accordance with DIN EN 15714 (Electric actuators for industrial valves – Basic requirements), and EN ISO 12944-2:1998 (Paints and varnishes. Corrosion protection of steel structures by protective paint systems. Classification of environments).

Electronic cabinet modules satisfy the requirements of category C1 (low pollution) as per EN ISO 12944-2:1998 (Paints and varnishes. Corrosion protection of steel structures by protective paint systems. Classification of environments).

### Service life

Contrac actuators and electronic units exceed the service life requirements for the highest class D, 'continuous modulation', as per DIN EN 15714 (Electric actuators for industrial valves – Basic requirements). The actuators remain maintenance-free for up to 10 years under 'normal' load.

## Communication

### HART

Contrac actuators also offer the option of using the HART® communication protocol for configuration and parameterization while operation is in progress. HART®-FSK communication enables simultaneous analog set point transmission and digital communication without additional installation. The HART signal is modulated onto the 4 to 20 mA analog set point signal. The HART® protocol works with Frequency Shift Keying (FSK) technology, based on the Bell 202 communication standard.

### DTM

The DTM (Device Type Manager) for Contrac actuators is based on FDT / DTM technology (FDT 1.2 / 1.2.1) and can either be integrated into a control system or loaded on a PC with DAT200 Asset Vision Basic. This allows you to work with the same user interface in the commissioning phase, during operation, and for servicing tasks, involving monitoring the device, setting parameters, and reading out data. Communication is based on the HART® protocol. Reading out data from the device has no effect on the operation in progress. Newly set parameters are saved in the non-volatile memory directly upon download to the device, and become active immediately.

### EDD

Similar to DTM, the EDD (Electronic Device Description) provides the option of configuration and parameterization of the device through HART® communication by using a handheld terminal or an EDD integrated in the system.

## Specification

### General information

#### EBS852

IP rating	IP 20
Humidity	≤ 75 % annual average; condensation not permitted
Rack air inlet temperature	0 to 45 °C (32 to 113 °F)
Transport and storage temperature	-25 to 70 °C (-13 to 158 °F)
Long-term storage temperature	-25 to 40 °C (-13 to 104 °F)
Mounting position	vertical; lateral connections, right
Vibration stress	2 to 9 Hz: maximum deflection: 3 mm (0.12 in) 9 to 200 Hz: acceleration: 1 g
Paint	2-layer component epoxy (RAL 9005, black)
Electrical connection	Mains supply via screw terminals; all other connections made via screw-type plug connectors Maximum cable length electronic unit – actuator: * 270 m at 1.5 mm <sup>2</sup> (885 ft at 16 AWG) 460 m at 2.5 mm <sup>2</sup> (1510 ft at 14 AWG)
Weight	11 kg (24 lbs)

\* The maximum cable length depends on the actuator type and cable cross-section, see '**Actuator assignment and maximum cable lengths**' in the **operating instruction**.

### Power supply

#### EBS852

Supply voltage (standard actuators)	115 V AC (94 to 130 V) or 230 V AC (190 to 260 V); 47.5 to 63 Hz; single-phase				
Supply voltage (Ex actuators)	115 V AC (94 to 127 V) or 230 V AC (190 to 253 V); 47.5 to 63 Hz; single-phase				
Average power loss $P_{avg}$ and power consumption $I_{max}$ of the electronic unit	Actuator	$P_{avg}$	$I_{max}$ at 115 V	$I_{max}$ at 230 V	$I_{pos}$ (115 V + 230 V): approx. 40 to 50 % of $I_{max}$
	RHD(E)250-10	60 W	1.8 A	0.9 A	
	RHD(E)500-10	75 W	2.2 A	1.1 A	
	RHD(E)800-10	60 W	5.0 A	2.5 A	
	RHD(E)1250-12	80 W	5.0 A	2.5 A	
	RHD(E)2500-25	80 W	5.0 A	2.5 A	
	RHD(E)4000-40	80 W	5.8 A	2.7 A	
	RHD(E)8000-80	80 W	5.0 A	2.5 A	
	RSD(E)10-5,0	55 W	2.2 A	1.1 A	
	RSD(E)10-10,0	60 W	3.6 A	1.8 A	
	RSD(E)20-5,0	60 W	3.6 A	1.8 A	
	RSD(E)20-7,5	75 W	4.8 A	2.4 A	
	RSD(E)50-3,0	75 W	5.0 A	2.5 A	
	RSD100-1.5	75 W	5.0 A	2.5 A	
External fuse for electronic unit	16 A, time-lag				
External fuse for heating (dewing protection)	2 to 6 A, medium time-lag				

## Communication

### Conventional communication

Analog input	0 / 4 to 20 mA, internal load: 300 Ω
Analog output	0 / 4 to 20 mA, electrically isolated, maximum load: 500 Ω
3 digital inputs, 1 to 3	Digital 0: -3 to 5 V or open, electrically isolated Digital 1: 12 to 35 V, electrically isolated
3 digital outputs, 1 to 3	Potential-free relay contact, max. 60 V, 150 mA
Digital communication	RS232 for commissioning and service, optionally FSK / HART®
Default settings	See Table <b>Conventional communication</b>
Voltage output U <sub>V</sub>	24 V, 15 mA, electrically isolated, for scanning external contacts, or similar applications
Connection for transmitter (optional)	Supply for two-wire transmitter with activated process controller in Contrac
Individual settings	See data sheet 'DS/CONTRAC/SETTING' or available upon request.

## Delivery status

### Conventional communication

Parameter	Setting
Function selection	Positioner, parameter: set point
Set point function	Analog set point
Set point range	4 to 20 mA
Set point characteristic	Linear; set point = position value
Actual value range	4 to 20 mA
Nominal torque / rated force in ±direction	100 %
Automatic speed in ±direction:	100 %
Action in 0 % / 100 % end position	Keep tight with nominal torque/rated force
Digital inputs	Digital input 1 Manual / Automatic switching, Digital input 2 / 3 Travel command ±
Digital outputs	Digital output 1 ready for operation / error message, Digital output 2/3 end position signal 0 %/100 %
Brake Away Function	Deactivated
Shut-off function	Deactivated
Positioning loop monitoring	Deactivated
Set point monitoring	Deactivated
Alarm Type	Deactivated
Action after restoration of power	Switch to Automatic
Working range of actuator	Not set

## Electrical connections

### Wire cross-sectional areas

EBS852 – Clamping connection		
	Suited for cable Ø	Terminals for conductor cross-section
Mains cable	13 mm (0.51 in)	max. 4 mm <sup>2</sup> (12 AWG)
Signal cable (DCS)	8 mm (0.31 in)	max. 1.5 mm <sup>2</sup> (16 AWG)
Transmitter (option)	8 mm (0.31 in)	max. 1.5 mm <sup>2</sup> (16 AWG)
Motor cable	13 mm (0.51 in)	max. 4 mm <sup>2</sup> (12 AWG)
Sensor cable	8 mm (0.31 in)	max. 1.5 mm <sup>2</sup> (16 AWG)

### Selection of suited connection cables

Please observe the following information when selecting cables:

- Use suited cables only for the electric connection between the Contrac control actuator in potentially explosive atmospheres and the components outside of the potentially explosive atmospheres.
- Use shielded cables for the motor / brake cable, the sensor cable, and the signal cable to the control system / controller.
- Connect the shielding of the motor / brake cable and the sensor cable on both sides (to the actuator and to the Contrac electronic unit).
- For the connection between the motor and motor temperature monitoring unit and for the power supply, shielded cables are not required.

### Installation information on the cable harness for actuators in Ex design

The electrical connection between the Contrac electronic unit and the Contrac actuator can be established using the cable set (order code 695). The cable harness is not part of the Ex prototype test certificate and must therefore be tested for safety-relevant functionality within the complete installation by the installer or operator.

If the specified cable harness does not meet all safety-relevant requirements, the proper installation material must be used.

For the specified motor connection cable, the shielding must be connected at both ends and connected with protective ground.

## Potential equalization

In order to avoid the risk of an electric shock, it must not be possible to come into contact with dangerous live parts and conductive parts that can be touched should not become dangerous live parts either under standard conditions or under conditions when a single fault occurs.

The actual current flowing in the event of a fault is obtained from the phase to ground voltage and the total impedance present in the fault circuit.

For long cables, the voltage drop may be dangerous to come into contact with high current flowing.

Preferably, the electronic unit and the actuator must be connected with low resistance (ground resistance < 0.1 Ω) to the potential equalization.

In the process, the respective standards of the VDE 100 series must be observed.

### Scenario 1

If the PE of the actuator is done only via the PE conductor of the motor cable, the maximum permissible cable lengths for the electronic units EAS822 and EBS852 are reduced in accordance with the following table.

The maximum permissible shutdown time of 200 ms in case of a fault is complied with in the process.

Max. cable length	EBS852	EBS862
Conductor cross-section		
1.5 mm <sup>2</sup> (16 AWG)	176 m (577 ft)	48 m (157 ft)
2.5 mm <sup>2</sup> (14 AWG)	235 m (771 ft)	79 m (259 ft)
4 mm <sup>2</sup> (12 AWG)	460 m (1509ft)	127 m (416 ft)
6 mm <sup>2</sup> (10 AWG)	-	190 m (623 ft)

### Scenario 2

By laying an extra potential equalization conductor between the electronic unit and the actuator, with a small conductor cross-section of the motor cable (e.g. 1.5 mm<sup>2</sup>), the maximum permissible cable length can be increased.

The ground resistance of the potential equalization conductor must be < 0.1 Ω.

The maximum permissible shutdown time of 200 ms in case of a fault is complied with in the process.

---

### Max. cable length

Conductor cross-section	EBS852	EBS862
4 mm <sup>2</sup> (12 AWG)	460 m (1509ft)	127 m (416 ft)
6 mm <sup>2</sup> (10 AWG)	460 m (1509ft)	190 m (623 ft)
10 mm <sup>2</sup> (8 AWG)	460 m (1509ft)	317 m (1040 ft)

### Scenario 3

If the cable lengths specified in **General information** on page 6 are fully utilized, an additional protective potential equalization must be connected.

To do this, the electronic unit and the actuator must be connected via a short cable with a minimum cross-section of 4 mm<sup>2</sup> (12 AWG) to the on-site potential equalization.

The installation regulations for setting up grounding systems must be observed and followed.


## ... Electrical connections

### Electronic Unit EBN852 (Contrac)

#### Standard Actuators

##### Note

The electrical connection is provided by a universal plug on the actuator and the screw terminals on the electronic unit.

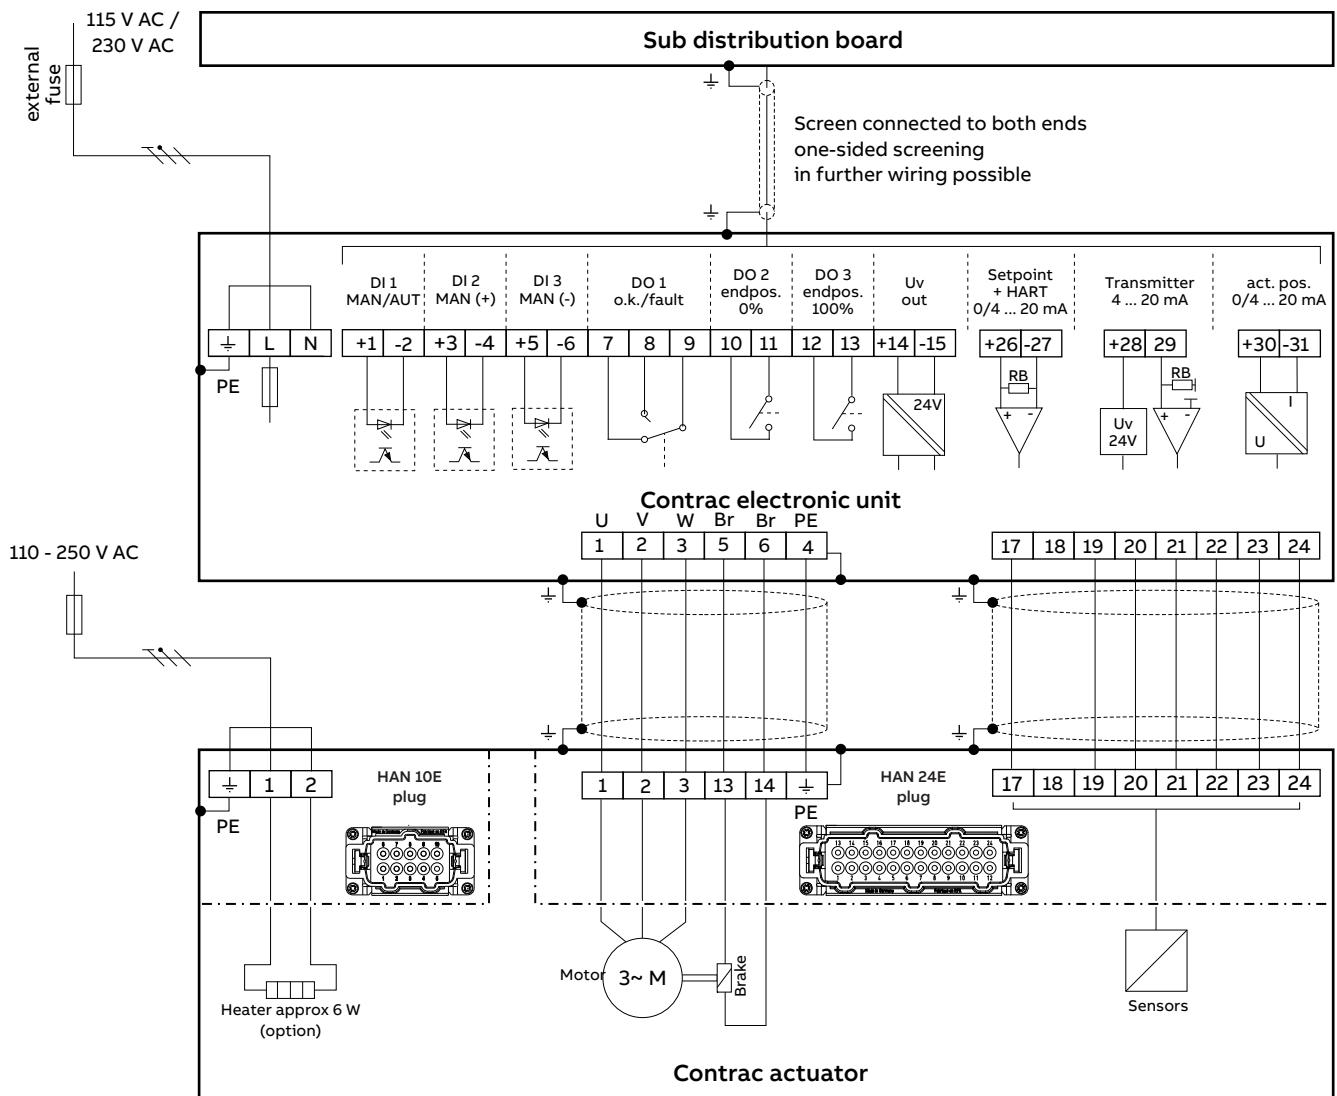

BE = digital input


BA = digital output

Figure 1: Control via analog input 0/4 to 20 mA, HART® communication or digital inputs

## Ex Actuators

### Note

- The electrical connection is established via screw terminals on the control actuator and on the electronic unit.
- If you are using a separate heat supply, the heater must be protected with a 2 to 6 A medium time-lag fuse (e.g. NEOZED D01 E14).

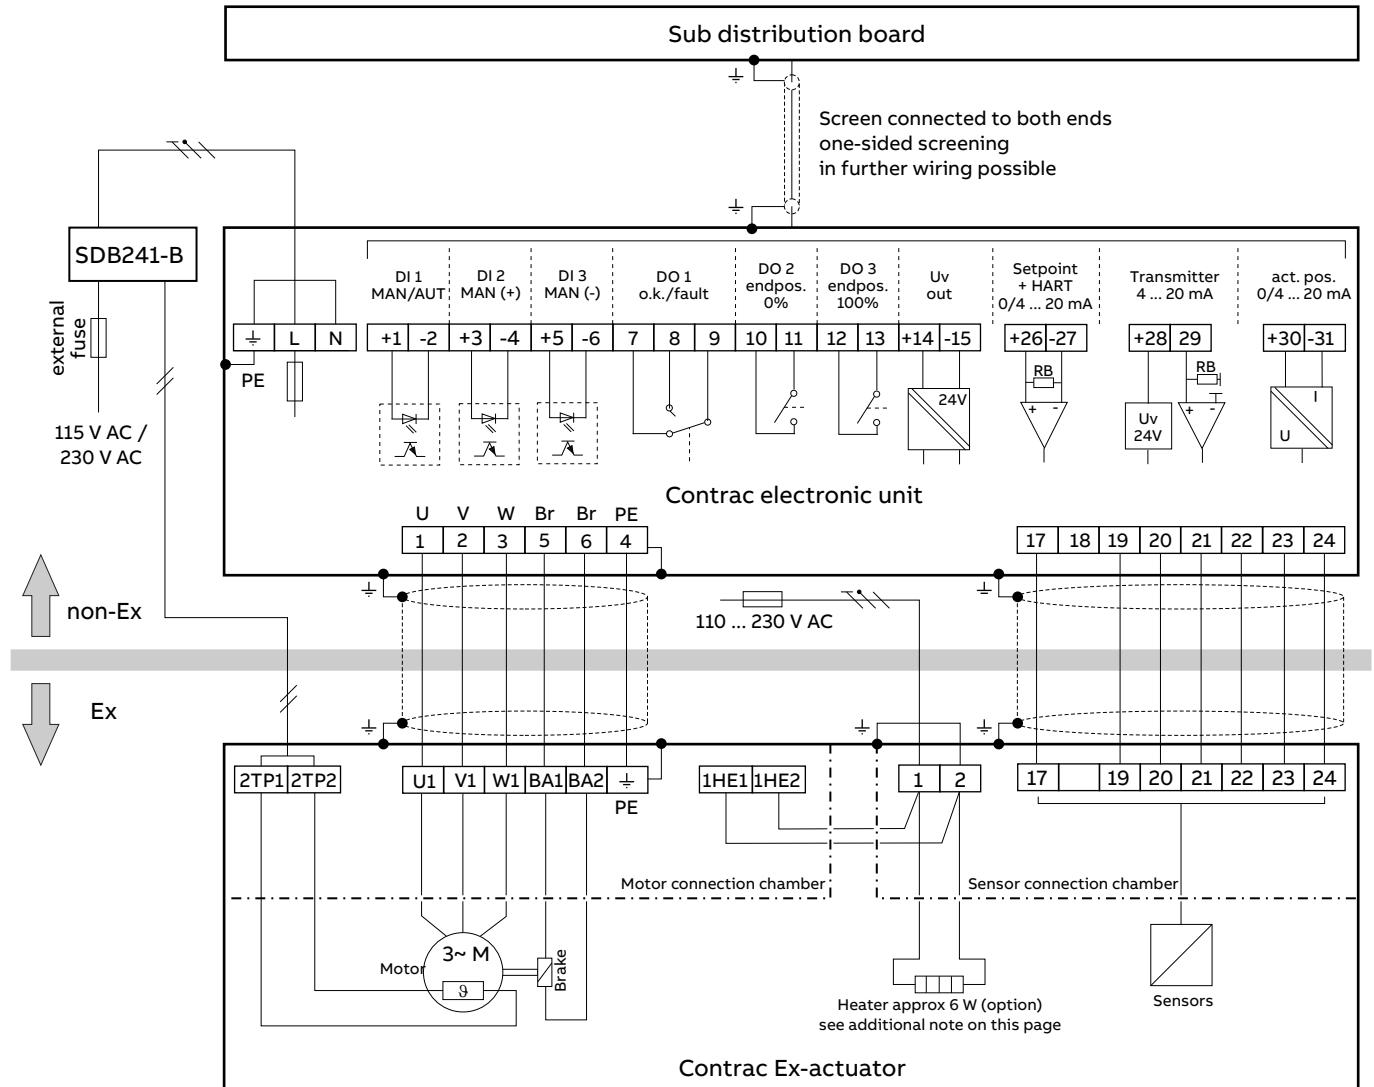

BE = digital input

BA = digital output

Figure 2: Control via analog input 0/4 to 20 mA, HART® communication or digital inputs

## Dimensions

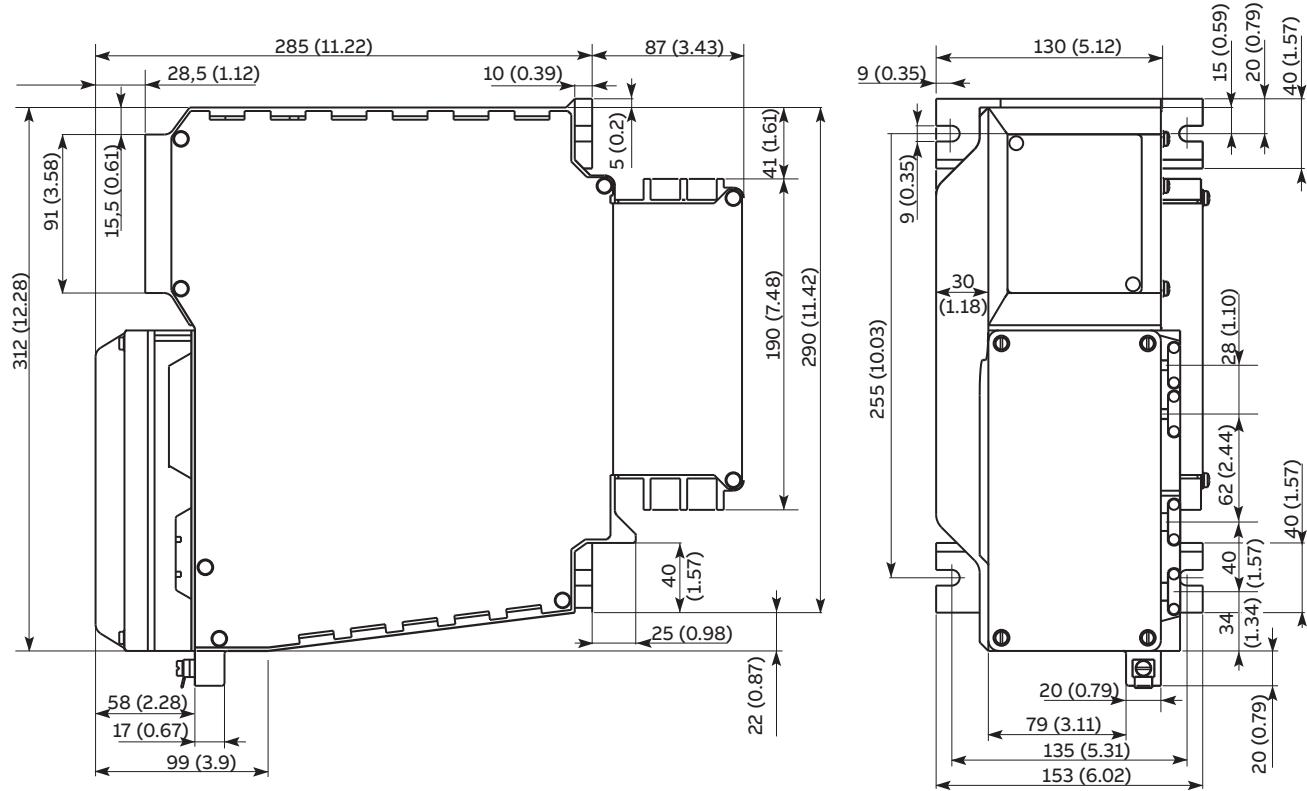


Figure 3: Dimensions in mm (in)

## Ordering Information

### Main ordering information EBS852 for Standard Actuators

Basic model	V68852A	XXXX	XXX	XXX	XXX	XXX	XXX
EBS852 Electronic Unit for Standard Actuators, for rack mounted installation							
<b>Suitable for</b>							
Linear Actuator RSD10-5,0/100	2050						
Linear Actuator RSD10-5,0/300	9150						
Linear Actuator RSD10-10,0/100	2051						
Linear Actuator RSD10-10,0/300	9151						
Linear Actuator RSD20-5,0/100	2052						
Linear Actuator RSD20-5,0/300	9152						
Linear Actuator RSD20-7,5/100	2053						
Linear Actuator RSD20-7,5/300	9153						
Linear Actuator RSD50-3,0/120	3054						
Linear Actuator RSD50-3,0/300	9154						
Linear Actuator RSD100-1,5/150	2155						
Linear Actuator RSD100-1,5/300	9155						
Linear Actuator RSD200-0,7/180	5456						
Linear Actuator RSD200-0,7/300	9156						
Part-Turn Actuator RHD250-10	0103						
Part-Turn Actuator RHD500-10	0104						
Part-Turn Actuator RHD800-10	0105						
Part-Turn Actuator RHD1250-12	0106						
Part-Turn Actuator RHD2500-25	0107						
Part-Turn Actuator RHD4000-40	0108						
Part-Turn Actuator RHD8000-80	0109						
<b>Supply Voltage</b>							
230 V AC 1 Ph		380					
115 V AC 1 Ph		381*					
<b>Frequency</b>							
50 Hz		382					
60 Hz		383					
<b>Digital Communication</b>							
RS 232		384					
RS 232 + HART®		385					

\* Not for: RSD20-7,5 / RSD50-3,0 / RSD100-1,5 / RSD200-0,7 / RHD1250-12 / RHD2500-25 / RHD4000-40 / RHD8000-80

Continued see  
next page

#### **... Ordering Information**

<b>Main ordering information</b>		
EBS852 Electronic Unit for Standard Actuators, for rack mounted installation	XXX	XXX
<b>Ambient Temperature Range of Actuator</b>		
-30 to 50 °C (-20 to 130 °F)	341	
-10 to 65 °C (15 to 150 °F)	344	
-1 to 85 °C (30 to 185 °F) (Only for RHD250 / RHD500 / RHD800 und RSD10 / RSD20)	349	
<b>Settings of Electronic Unit</b>		
Standard settings (see technical data)		390
Customer-specific settings (see data sheet 10/68-2.40 EN)		391

#### **Additional ordering information EBS852 for Standard Actuators**

EBS852 Electronic Unit for Standard Actuators, for rack mounted installation	XXX							
<b>Anti-condensation Heater in Actuator "ON"</b>								
Anti-condensation heater in actuator "ON"	359							
<b>Identification on Data Label</b>								
(Alphanumeric, max. 32 characters)	295							
<b>Data Label with US Units</b>								
Data label with US units	253							
<b>F. No. of associated Actuator on Data Label of Electronic Unit</b>								
F. No. of associated actuator on data label of electronic unit (Available only as "Special Requirement")	297							
<b>Factory Certificate 2.1 acc. to EN 10204</b>								
Factory certificate 2.1 acc. EN 10204	291							
<b>Certificate 3.1 acc. to EN 10204</b>								
Certificate 3.1 acc. EN 10204	292							
<b>Operating Instruction</b>								
German	Z1D							
English	Z1E							
Portuguese	Z1P							
Italian	Z1I							
French	Z1F							
<b>Positioner / Controller Function</b>								
Positioner function	238							
Process controller function	239							

## EBS852 for Ex-Actuators

Basic model	V68852A	XXXX	XXX	XXX	XXX	XXX	XXX
EBS852 Electronic Unit for Ex-Actuators, for rack mounted installation							
<b>Suitable for</b>							
Linear Actuator RSDE10-5,0/100	2076						
Linear Actuator RSDE10-5,0/300	9176						
Linear Actuator RSDE10-10,0/100	2077						
Linear Actuator RSDE10-10,0/300	9177						
Linear Actuator RSDE20-5,0/100	2078						
Linear Actuator RSDE20-5,0/300	9178						
Linear Actuator RSDE20-7,5/100	2079						
Linear Actuator RSDE20-7,5/300	9179						
Linear Actuator RSDE50-3,0/120	3080						
Linear Actuator RSDE50-3,0/300	9180						
Part-Turn Actuator RHDE250-10	0110						
Part-Turn Actuator RHDE500-10	0119						
Part-Turn Actuator RHDE800-10	0120						
Part-Turn Actuator RHDE1250-12	0128						
Part-Turn Actuator RHDE2500-25	0129						
Part-Turn Actuator RHDE4000-40	0157						
Part-Turn Actuator RHDE8000-80	0158						
<b>Supply Voltage</b>							
230 V AC 1 Ph	380						
115 V AC 1 Ph	381*						
<b>Frequency</b>							
50 Hz	382						
60 Hz	383						
<b>Digital Communication</b>							
RS 232	384						
RS 232 + HART®	385						
<b>Ambient Temperature Range of Actuator</b>							
-25 to 60 °C (-15 to 140 °F) (Only for part turn actuators Ex)	346						
-30 to 40 °C (-22 to 104 °F) (Only for part turn actuators Ex)	347						
-20 to 60 °C (-4 to 140 °F) (Only for linear actuators Ex)	348						
<b>Settings of Electronic Unit</b>							
Standard settings (see technical data)	390						
Customer-specific settings (see data sheet 10/68-2.40 EN)	391						

\* Not for: RSDE20-7,5 / RSDE50-3,0 / RSDE100-1,5 / RHDE1250-12 / RHDE2500-25 / RHDE4000-40 / RHDE8000-80

## ... Ordering Information

### Additional ordering information EBS852 for Ex-Actuators

EBS852 Electronic Unit for Ex-Actuators, for rack mounted installation	XXX							
<b>Anti-condensation Heater in Actuator "ON"</b>								
Anti-condensation heater in actuator "ON"	359							
<b>Identification on Data Label</b>								
(Alphanumeric, max. 32 characters)	295							
<b>Data Label with US Units</b>								
Data label with US units	253							
<b>F. No. of associated Actuator on Data Label of Electronic Unit</b>								
F. No. of associated actuator on data label of electronic unit (Available only as "Special Requirement")	297							
<b>Factory Certificate 2.1 acc. to EN 10204</b>								
Factory certificate 2.1 acc. EN 10204	291							
<b>Certificate 3.1 acc. to EN 10204</b>								
Certificate 3.1 acc. EN 10204	292							
<b>Operating Instruction</b>								
German	Z1D							
English	Z1E							
Russian	Z1R							
<b>Positioner / Controller Function</b>								
Positioner function	238							
Process controller function	239							

## Accessories

Description	Ordering number
RHD(E) / RSD(E) / PME / LME Save & Restore Tool ECOM700 for Contrac electronic units with software version $\geq$ 2.0	3KXE911100L0001
RHD(E) / RSD(E) / PME / LME Save & Restore Tool ECOM688 for Contrac electronic units with software version $<$ 2.0	3201110
RHD(E) / RSD(E) / PME / LME PC connection cable, 3 m cable with 9-pole Sub-D connector and 9-pole Sub-D female connector	746349

---

## Trademarks

HART is a registered trademark of FieldComm Group, Austin, Texas, USA

Sales



Service



---

**Notes**



---

**ABB Limited**  
**Measurement & Analytics**  
Howard Road, St. Neots  
Cambridgeshire, PE19 8EU  
UK  
Tel: +44 (0)870 600 6122  
Fax: +44 (0)1480 213 339  
Email: [enquiries.mp.uk@gb.abb.com](mailto:enquiries.mp.uk@gb.abb.com)

**ABB Inc.**  
**Measurement & Analytics**  
125 E. County Line Road  
Warminster, PA 18974  
USA  
Tel: +1 215 674 6000  
Fax: +1 215 674 7183

**ABB Automation Products GmbH**  
**Measurement & Analytics**  
Schillerstr. 72  
32425 Minden  
Germany  
Tel: +49 571 830-0  
Fax: +49 571 830-1806

**[abb.com/actuators](http://abb.com/actuators)**

---

We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders, the agreed particulars shall prevail.  
ABB does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein.  
Any reproduction, disclosure to third parties or utilization of its contents – in whole or in parts – is forbidden without prior written consent of ABB.

Copyright© 2018 ABB  
All rights reserved

3KXE181005R1001